

TYPE EXAMINATION CERTIFICATE

Equipment or Protective System Intended for use in Potentially Explosive Atmospheres UKSI 2016:1107 (as amended)

- 1 Type Examination Certificate Number: **BAS22UKEX0040X**
- 2 Product: **D2-FF Valvetop Switchbox**
- 3 Manufacturer: **Topworx Incorporated**
- 4 Address: **3300 Fern Valley Road, Louisville, Kentucky, 40213
United States of America**
- 5 This product and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.
- 6 SGS Baseefa certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Schedule 1 of the Equipment and Protective Systems Intended for Use in Potentially Explosive Atmospheres Regulations 2016, UKSI 2016:1107 (as amended).
- 7 The examination and test results are recorded in confidential Report No. **GB/BAS/ExTR22.0047/00**
- 8 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:
EN IEC 60079-0:2018 EN 60079-7:2015+A1:2018 EN IEC 60079-15:2019 EN 60079-31:2014
- 9 except in respect of those requirements listed at item 18 of the Schedule.
- 10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.
- 11 This TYPE EXAMINATION CERTIFICATE relates only to the design of the specified product and not to specific products subsequently manufactured.
- 12 The marking of the product shall include the following :
- Ex II 3GD Ex ec nC IIC T6 Gc (-20°C ≤ Ta ≤ +50°C)
Ex tc IIIC T80°C Dc IP67 (-20°C ≤ Ta ≤ +50°C)**

SGS Baseefa Customer Reference No. **2191**

Project File No. **21/0624**

This document is issued by the Company subject to its General Conditions for Certification Services accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and the Supplementary Terms and Conditions accessible at <http://www.sgs.com/SGSBaseefa/Terms-and-Conditions.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Baseefa Limited

Rockhead Business Park, Staden Lane,
Buxton, Derbyshire SK17 9RZ

Telephone +44 (0) 1298 766600 Fax +44 (0) 1298 766601
e-mail baseefa@sgs.com web site www.sgs.co.uk/sgsbaseefa

Registered in England No. 4305578.

Registered address: Rossmore Business Park, Ellesmere Port, Cheshire,
CH65 3EN



R S Sinclair

R S SINCLAIR
TECHNICAL MANAGER
On behalf of SGS Baseefa
Limited

13

Schedule

14

Certificate Number BAS22UKEX0040X

15 Description of Product

The D2-FF Valvetop Switchbox is designed to control and provide feedback of the position of an actuator / valve combination located in the hazardous area via a Foundation Fieldbus or FISCO network.

The equipment comprises an enclosure either made of stainless Steel (DXS models), coated aluminium (DXP models) or glass fibre reinforced resin enclosure (DXR models) housing a FF CC Electronic Unit, up to two certified piezoelectric pilot valves and up to two limit switches. A shaft assembly passes through the enclosure base to which a disc with metallic contacts is fitted to activate limit switches fitted around the shaft. Based on the inputs from the devices fitted, the FF CC Electronic Unit processed the information and communicates it via the Fieldbus network. The FF CC Electronic Unit also controls the operation of the pilot valves, when fitted, which are connected to the pneumatic valves attached to the side of the enclosure.


On top of the Switchbox enclosure a visual indicator is fitted which mechanically connects to the shaft assembly inside to provide an indication of the position of the actuator / valve to which the equipment is connected.

External connections to the equipment are made using a plug and socket connector with screw terminals via one of two threaded entries on either side of the enclosure. The installation of external connections and the plugging of the unused entry must be carried out using appropriate Ex e or Ex n cable glands or blanking plug components with a minimum IP rating of IP67 certified by an approved certification body.

Input Parameters – Bus Connector J1

Maximum Working Voltage = 32V d.c

The following model range is covered by this certificate: -

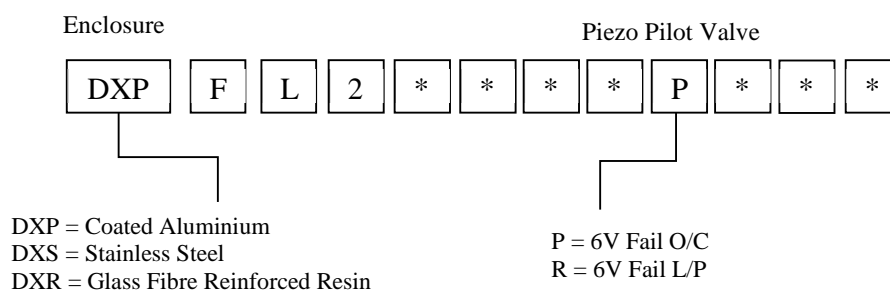

* Denotes any number or character

16 Report Number

GB/BAS/ExTR22.0047/00

17 Specific Conditions of Use

1. When fitted, only non-combustible fluids may be used in the pneumatic circuit.
2. **DXR Models Only:** The equipment shall only be installed in a location where there is a low risk of mechanical damage. The enclosure constitutes a potential electrostatic risk and must only be cleaned with a damp cloth.
3. The cable glands fitted by the user must be appropriately certified in accordance with the requirements of IEC 60079-0 and provide a minimum degree of protection of at least IP67.

4. Unused entries into the enclosure must be fitted by the user with appropriately certified blanking elements that maintain the IP67 rating of the equipment.
5. The equipment must be installed in an area of Pollution Degree 2 or better, as defined in IEC 60664-1.

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product, and conformity is demonstrated in the report:

Clause	Subject
13	LVD type requirements
14	Overloading of equipment (protection relays, etc.)
21 (1)	External effects
21 (2)	Aggressive substances, etc.

19 Drawings and Documents

Number	Sheet	Issue	Date	Description
CERT-ES-09222-1	1 of 1	AA	03/14/2022	Assembly, Nameplate DXP/DXS/DXR W/D2-FF Non-Sparking

For all other drawings see Baseefa11ATEX0036X Issue 1.